

The City of Norfolk Department of Utilities is committed to providing residents and businesses throughout the City with top quality water service. Utilities' employees are on-call 24 hours a day, 365 days a year to ensure that you always have access to safe Norfolk drinking water. The Water Quality Report is distributed annually to inform our customers that we are meeting all water quality guidelines set forth by the Environmental Protection Agency.

Once again in 2014, Norfolk tap water met all federal requirements.

**City of Norfolk
Department of Utilities
Contact Information:**

400 Granby Street
Norfolk, VA 23510

Mailing Address: P.O. Box 1080
Norfolk, VA 23501

Customer Service: 757-664-6700
Water & Sewer Emergencies: 757-823-1000
Water Quality Lab: 757-441-5678

www.norfolk.gov/utilities

Department of Utilities

P.O. Box 1080

Norfolk, Virginia 23510-1080



**Department
of Utilities**


2015 Water Quality Report

Based on 2014 Testing Data



**Top Quality Drinking Water
Top Quality Service
757-664-6700
www.norfolk.gov/utilities**

Please share this information with people who drink this water, especially those who may not have received this notice directly. You can do this by posting this notice in a public place or by distributing copies by hand or by mail.

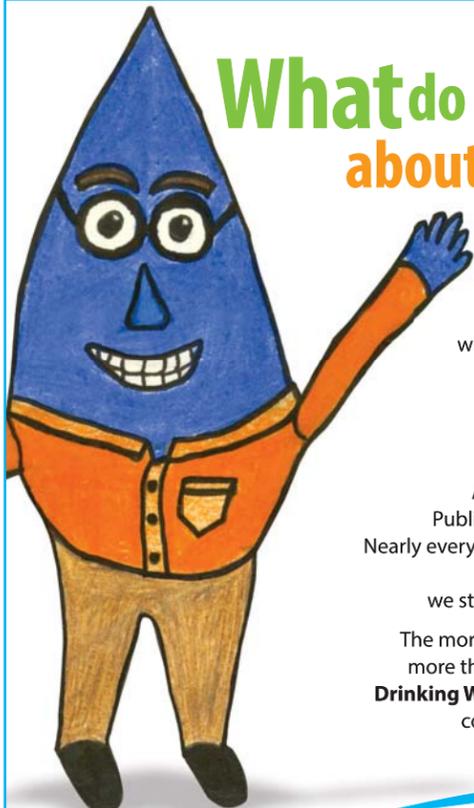

What do you know about H₂O?

Water—You rely on it daily, but what do you really know about it? There is so much more to H₂O than you realize!

Did you know that tap water provides us with...
A low-cost way to stay hydrated,
Public health and fire protection and
Nearly every product that we use every day?
Because of tap water,
we stay hydrated, healthy and happy.

The more you know about your H₂O, the more there is to love! To learn more this **Drinking Water Week**, visit drinktap.org or contact your local water provider.


Artwork provided by: Dawson T. Probst




Drinking Water Week MAY 3-9, 2015

Norfolk Tap Water

The healthy, refreshing choice.

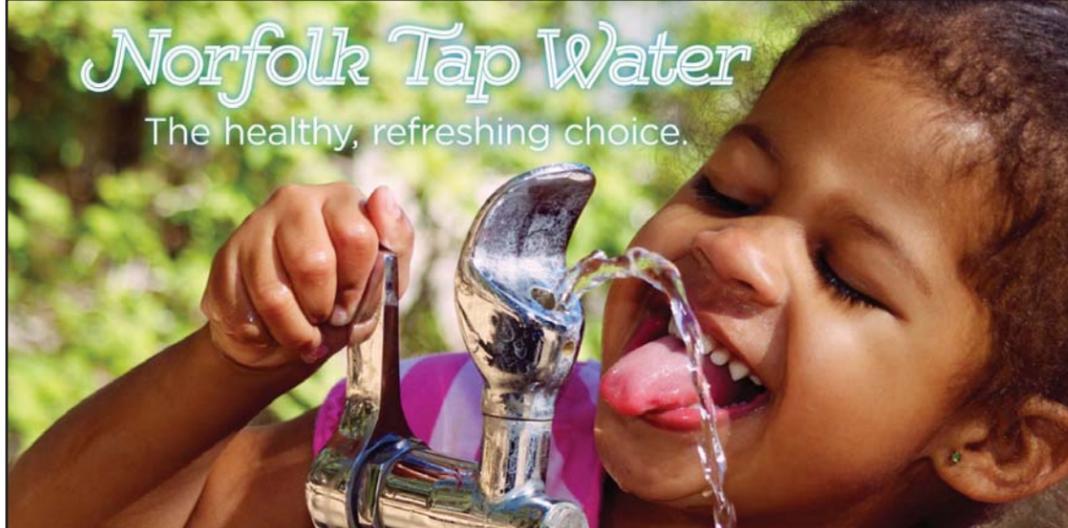





If you have any questions about the Water Quality Report, please contact the Water Quality Lab at 757-441-5678.

Norfolk Utilities' Water Quality staff includes Water Quality Manager Alicia Connelly, Chemists Maxine Burkett, Bettie Cahoon, Rachel Calcagni, Bob Cox, Julie Gilliam, Winnie Jaro, Ernest Maranan and Mignonne Wint.

The City of Norfolk obtains its raw (untreated) water from eight reservoirs, two rivers and four deep wells. The map at right shows the location of each of your water sources. From these sources, raw water is pumped to one of the Department of Utilities' two water treatment plants, where it is filtered and disinfected. Once tested to meet water quality standards, Norfolk drinking water is pumped on demand to your tap.

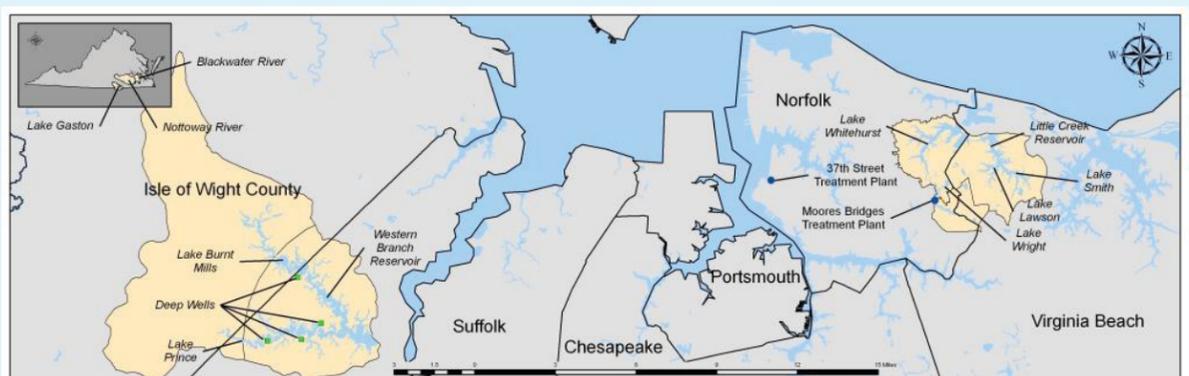

Definitions

- AL (action level)**, the amount required to trigger treatment or other action
- LIKELY SOURCE**, where it could come from
- MCL (maximum contaminant level)**, the highest level allowed by regulation
- MCLG (maximum contaminant level goal)**, the ideal goal
- MRDL (maximum residual disinfectant level)**, the highest level of a disinfectant allowed in drinking water
- MRDLG (maximum residual disinfectant level goal)**, the level of a drinking water disinfectant below which there is no known or expected risk to health
- MICROBIOLOGICAL CONTAMINANTS** are used as an indicator that other, potentially harmful bacteria may be present
- Norfolk's Average Level**, the average level of a detected compound or water quality parameter
- Norfolk's Highest Level**, Norfolk's single highest level of a detected compound or water quality parameter
- REGULATED SUBSTANCES** are regulated by the EPA and they cannot be above the MCL
- SMCL (Secondary Maximum Contaminant Levels)**, which are recommendations
- TT (treatment technique)**, a required process intended to reduce the level of a substance in drinking water
- TURBIDITY** is a measure of the cloudiness of water, which is not necessarily harmful, but can interfere with the disinfection of drinking water
- UNREGULATED MONITORED SUBSTANCES** are not regulated by the EPA, but they must be monitored so information about their presence in drinking water can be used to develop limits

Table Key

- ppm – One part per million (equivalent to 1 minute in 2 years).
 ppb – One part per billion (equivalent to 1 minute in 2,000 years).
 pCi/L – Picocuries per liter (measure of radioactivity).
 NTU – Nephelometric Turbidity Unit (measure of very small particulate matter in drinking water).
 > – Greater than.
 ND – Not detected in the water.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals, and in some cases, radioactive material. It can also pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source (raw) water include:

- Microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants**, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.
- Radioactive contaminants**, which can be naturally-occurring or be the result of oil and gas production and mining activities.

In 2001 the Hampton Roads Planning District Commission conducted a study on all the raw water sources in the area, including Norfolk's, to determine the susceptibility of reservoirs, rivers, and wells to contamination. Norfolk's susceptibility has been rated high. Norfolk's water treatment process ensures you receive high quality treated tap water that meets all Federal Safe Drinking Water Act requirements. For a copy of this study contact Norfolk's Water Quality Lab at 757-441-5678.

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limitations for contaminants in bottled water which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small (trace) amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. **Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS, or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from:**

**Environmental Protection Agency's
 Safe Drinking Water Hotline
 800-426-4791**

For questions regarding this report contact Norfolk's Water Quality Lab at 757-441-5678. For more information about decisions affecting your drinking water quality, you may attend Norfolk City Council meetings. For times and agendas, call the City Clerk's office at 757-664-4253.

Regulated Substances

Substance	Likely Source	Norfolk's Measured Range	Norfolk's Highest Level	Norfolk's Average Level	National MCL	National MCLG	Unit	Meets EPA Standards
2, 4-D	Field and lawn herbicide runoff	ND - 0.4	0.4	ND	70	70	ppb	<input checked="" type="checkbox"/>
Barium	Erosion of natural deposits	0.03 - 0.04	0.04	0.03	2	2	ppm	<input checked="" type="checkbox"/>
Chloramine	Drinking water disinfectant	3.1 - 3.5	3.5	3.3	4 ²	4 ³	ppm	<input checked="" type="checkbox"/>
Dalapon	Field herbicide runoff	ND - 1	1	ND	200	200	ppb	<input checked="" type="checkbox"/>
Fluoride	Added to prevent tooth decay	0.1 - 1.0	0.7 ¹	0.6	4	4	ppm	<input checked="" type="checkbox"/>
Nitrate as Nitrogen	Erosion of natural deposits, runoff	0.03 - 0.18	0.18	0.10	10	10	ppm	<input checked="" type="checkbox"/>
Total Organic Carbon	Occurs naturally in environment	1.8 - 2.9 ¹	2.7 ¹	2.3	TT	n/a	ppm	<input checked="" type="checkbox"/>

¹Highest monthly average for calendar year ²MRDL ³MRDLG

Substance	Likely Source	Norfolk's Measured Range	Norfolk's Average Level	Norfolk's Highest Quarterly Running Annual Average	Quarterly Running Annual Average		Unit	Meets EPA Standards
		(Individual Results)			National MCL	National MCLG		
Haloacetic Acids (HAA5)	Byproduct of disinfection process	15 - 33	26	27	60	0	ppb	<input checked="" type="checkbox"/>
Trihalomethanes (TTHM)	Byproduct of disinfection process	24 - 56	43	46	80	0	ppb	<input checked="" type="checkbox"/>

Turbidity

Substance	Likely Source	Norfolk's Lowest Monthly % of Samples Meeting Limit	Norfolk's Highest Level (NTUs)	National MCL	National MCLG	Unit	Meets EPA Standards
Turbidity	Soil runoff	100%	0.25	<1.0 maximum, and ≤0.3 95% of the time	n/a	NTU	<input checked="" type="checkbox"/>

Microbiological Contaminants

Substance	Likely Source	Norfolk Samples Indicating Bacteria Present	Norfolk's Highest Monthly % of Positive Samples	Norfolk's Months of Presence	National MCL	National MCLG	Meets EPA Standards
Total Coliform Bacteria	Natural in environment	3	1.2%	Jan, Aug	5% of samples per month positive for total coliform	0%	<input checked="" type="checkbox"/>

Lead and Copper in Customers' Homes (data from 2014 triennial sampling)

Norfolk has extremely low lead levels in its drinking water system. Because of this, the EPA has placed Norfolk on a reduced monitoring schedule. In 2014, no lead was detected at the monitoring level.¹

Substance	Likely Source	Norfolk's Results ¹	Norfolk Homes Exceeding Action Level	National Action Level	Unit	MCLG	Meets EPA Standards
Lead	Household plumbing corrosion	< 2.5	0	15	ppb	0	<input checked="" type="checkbox"/>
Copper	Household plumbing corrosion	0.12	0	1.3	ppm	1.3	<input checked="" type="checkbox"/>

¹Lead and copper compliance is measured at the 90th percentile of all samples taken during the 2014 triennial sampling period.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The Norfolk Department of Utilities is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (800-426-4791) or at <http://www.epa.gov/safewater/lead>.

Secondary and Unregulated Monitored Substances

Substance	Likely Source	Norfolk's Range	Norfolk's Highest Level	Norfolk's Average Level	National SMCL ¹	Unit
Aluminum	Erosion of natural deposits; also from the use of chemicals at water treatment plant	0.01 - 0.05	0.05	0.02	0.20	ppm
Chloride	Natural in environment	13 - 21	21	17	250	ppm
Iron	Natural in environment	ND - 0.22	0.22	0.05	0.3	ppm
Manganese	Natural in environment	ND - 0.02	0.02	0.01	0.05	ppm
pH	Adjusted during the water treatment process	7.5 - 7.7 ¹	7.7 ¹	7.6 ¹	6.5 - 8.5	pH units
Nickel	Corrosion of plumbing materials	ND - 0.004	0.004	0.002	n/a	ppm
Sodium	Natural in environment; also from the use of chemicals at water treatment plant	10 - 26	26	16	n/a ²	ppm
Sulfate	Natural in environment; also from the use of chemicals at water treatment plant	25 - 37	37	32	250	ppm
Total Dissolved Solids	Natural in environment	94 - 118	118	109	500	ppm
Zinc	Natural in environment; also from the use of chemicals at water treatment plant	0.02 - 0.19	0.19	0.12	5	ppm

¹Highest monthly average for calendar year ²For physician-prescribed "no salt diets," a limit of 20 ppm is suggested

Additional Information

The substances listed below are not regulated by the EPA; however, the Water Quality Lab provides this information as a service to our customers.

Substance	Norfolk's Range	Norfolk's Average Level	Unit
Alkalinity	21 - 35	28	ppm
Ammonia	0.04 - 0.14	0.10	ppm
Hardness	34 - 66	50	ppm
Silica	3 - 7	6	ppm

Unregulated Contaminant Monitoring Rule

EPA uses the Unregulated Contaminant Monitoring (UCM) program to collect data for contaminants suspected to be present in drinking water, but that do not have health-based standards set under the Safe Drinking Act (SDWA). Every five years EPA reviews the list of contaminants and selects no more than 30 for a nationwide drinking water survey to provide occurrence data for potential future regulations. The final sampling for UCMR3 occurred in August 2014. For more information, go to EPA's UCMR3 site: <http://water.epa.gov/lawsregs/rulesregs/sdwa/ucmr/ucmr3/index.cfm>

Substance	Norfolk's Range	Norfolk's Average Level	Unit
Chlorate	0.19 - 0.48	0.35	ppm
Chromium-6	0.03 - 0.08	0.05	ppb
Strontium	0.06 - 0.09	0.07	ppm